

**DRAWINGS MARKED TO SHOW
CHANGES MADE**

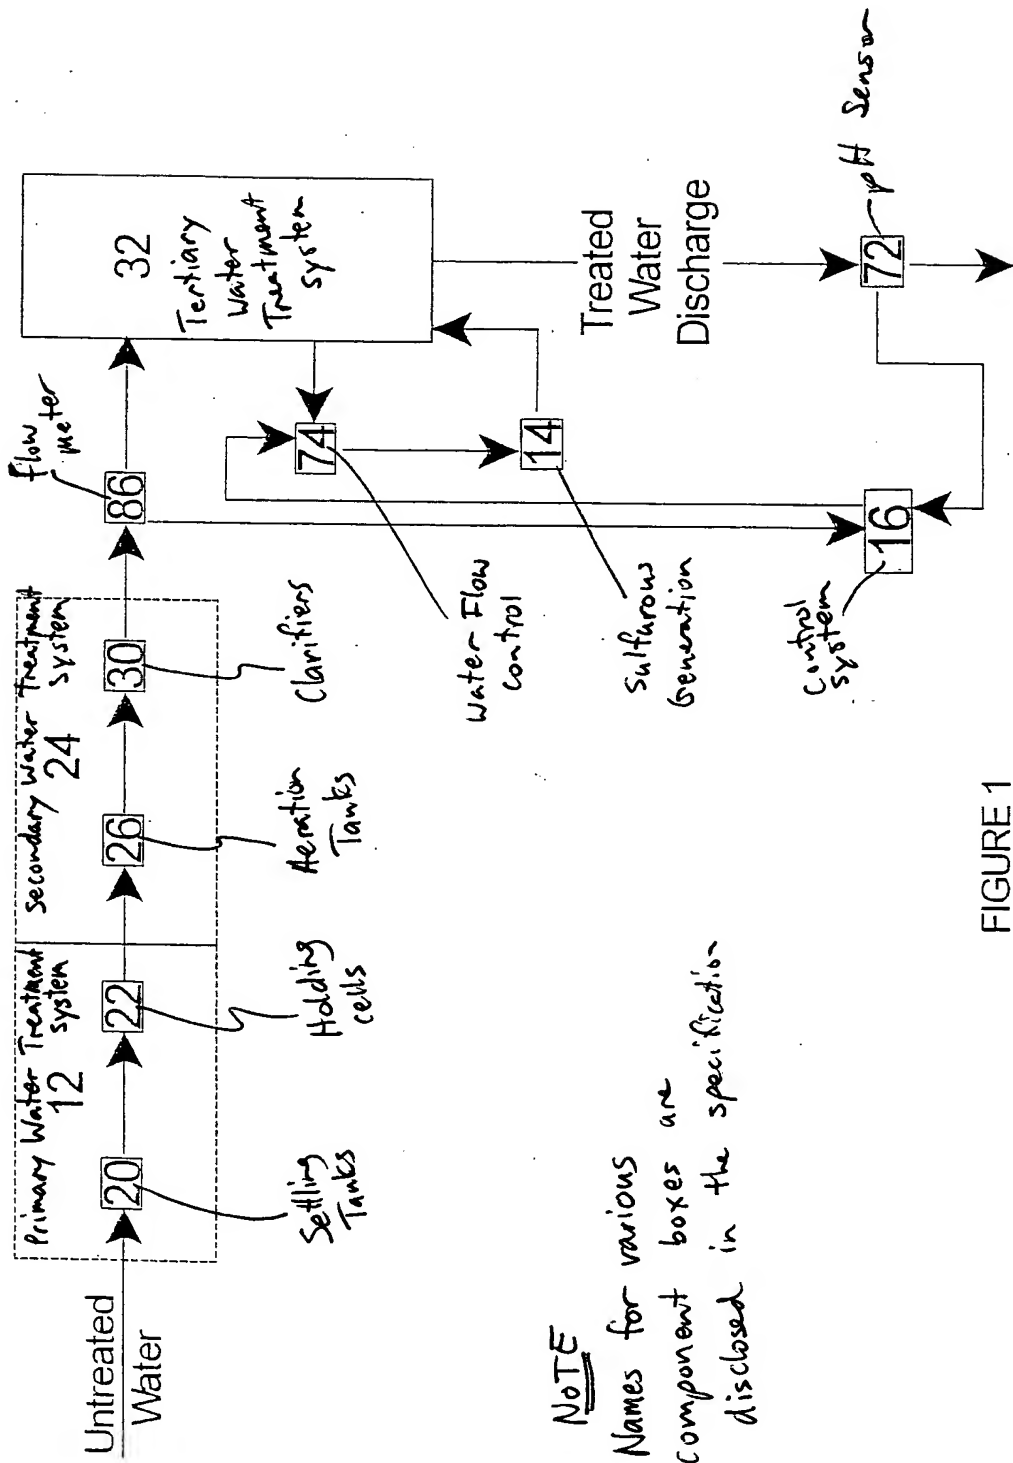
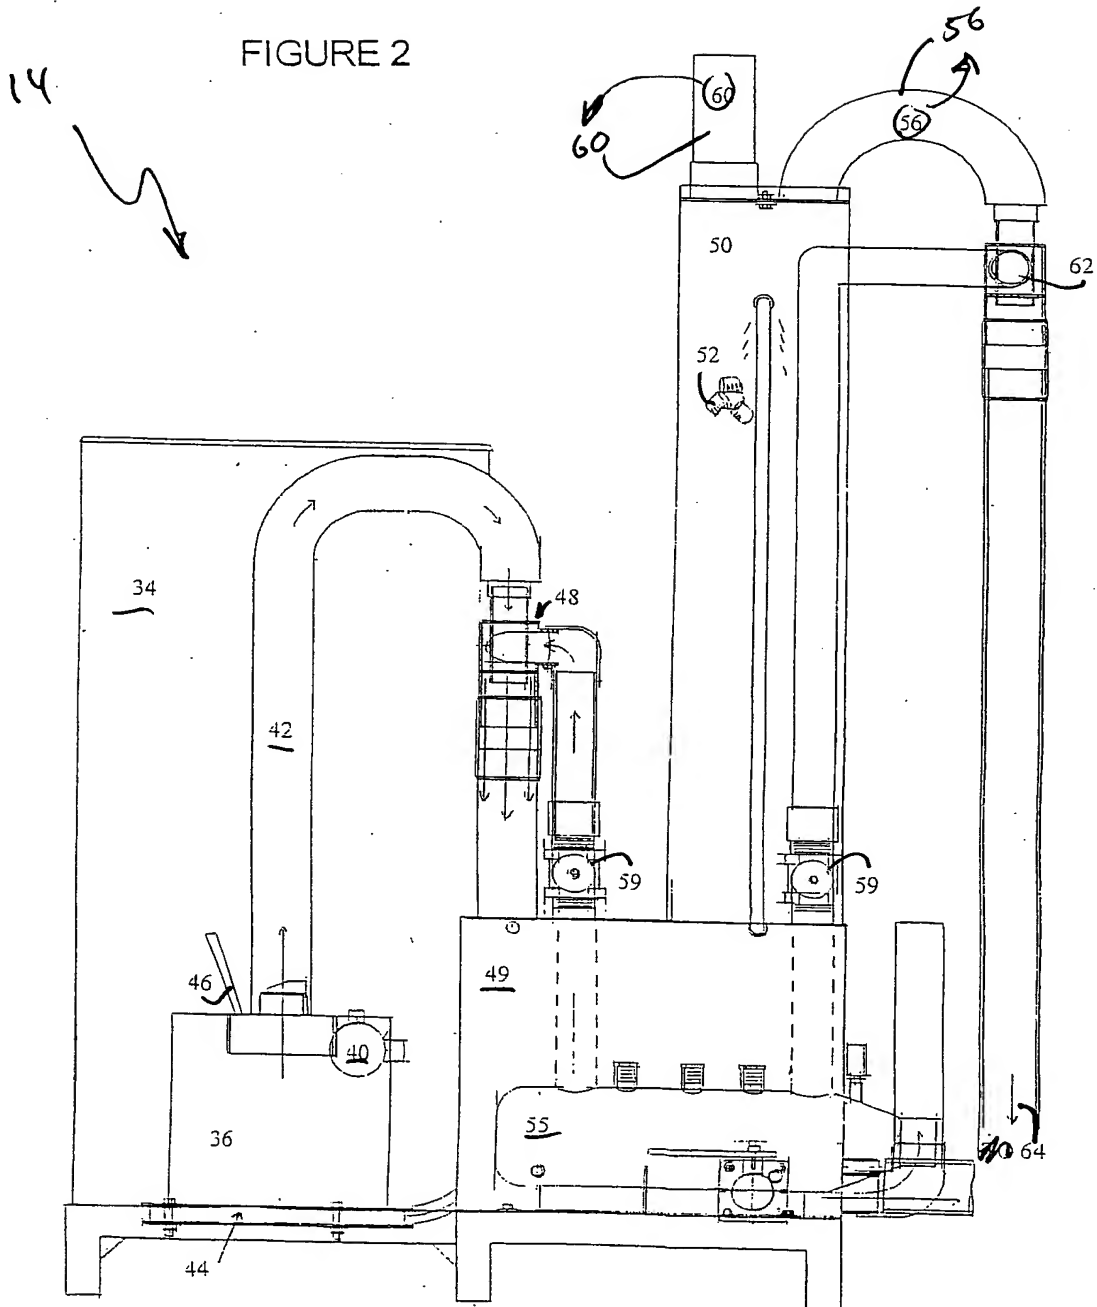




FIGURE 1

* NOTE
 Names for various
 component boxes are
 disclosed in the specification



FIGURE 2



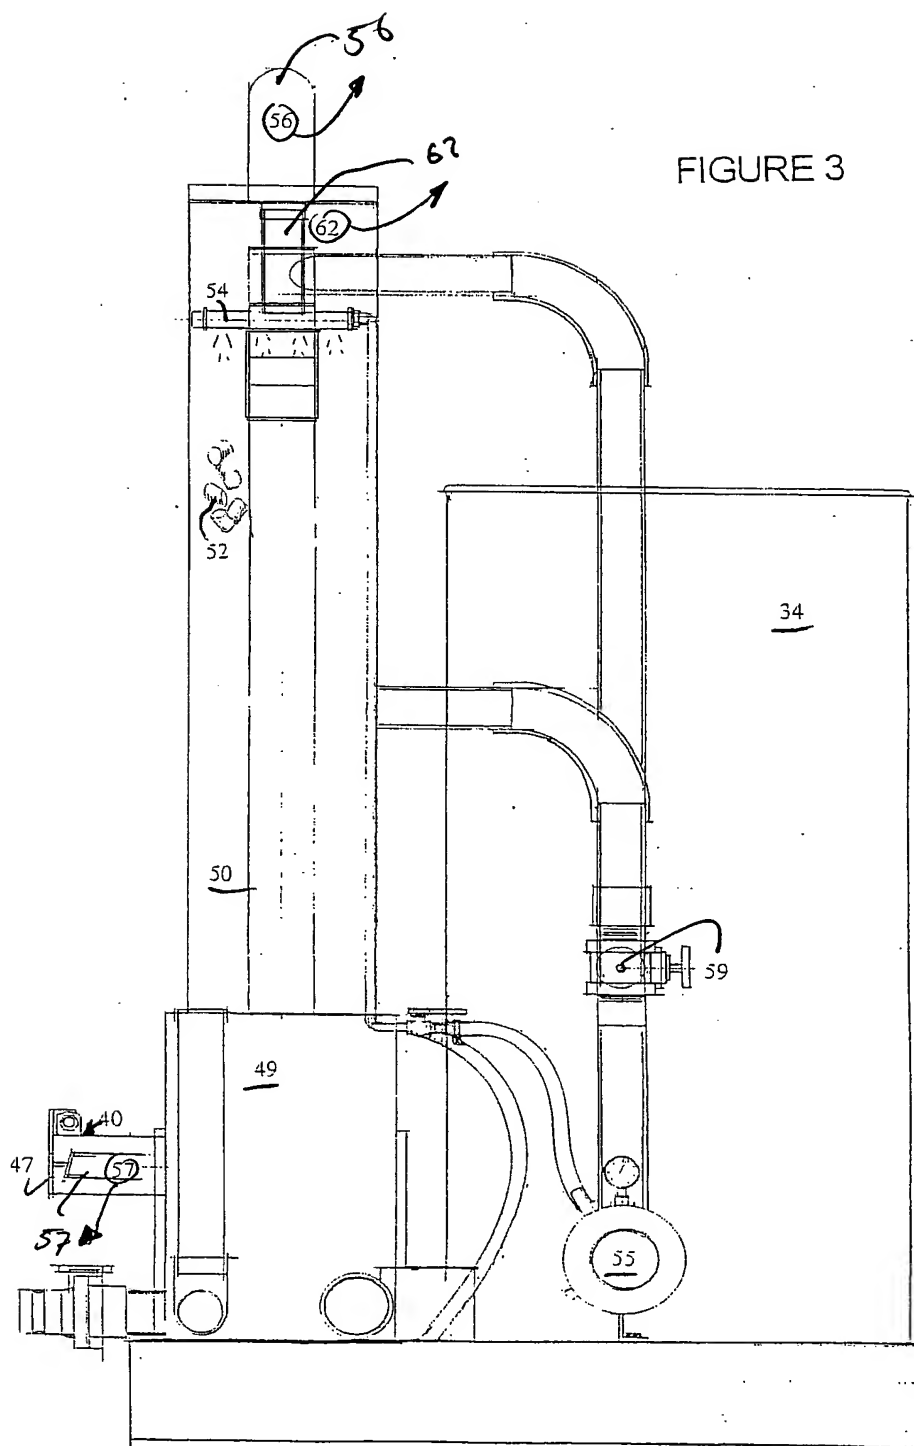

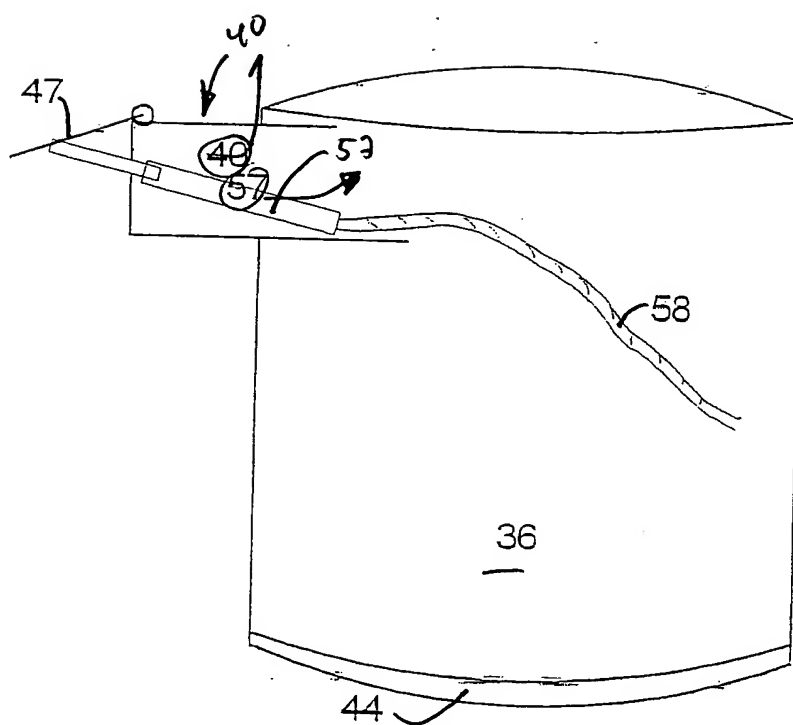


FIGURE 4

Scrub Tower Relative Tail Removal Efficiency

(5 = High Efficiency 1 = Low Efficiency)

Inner Diameter (inches)


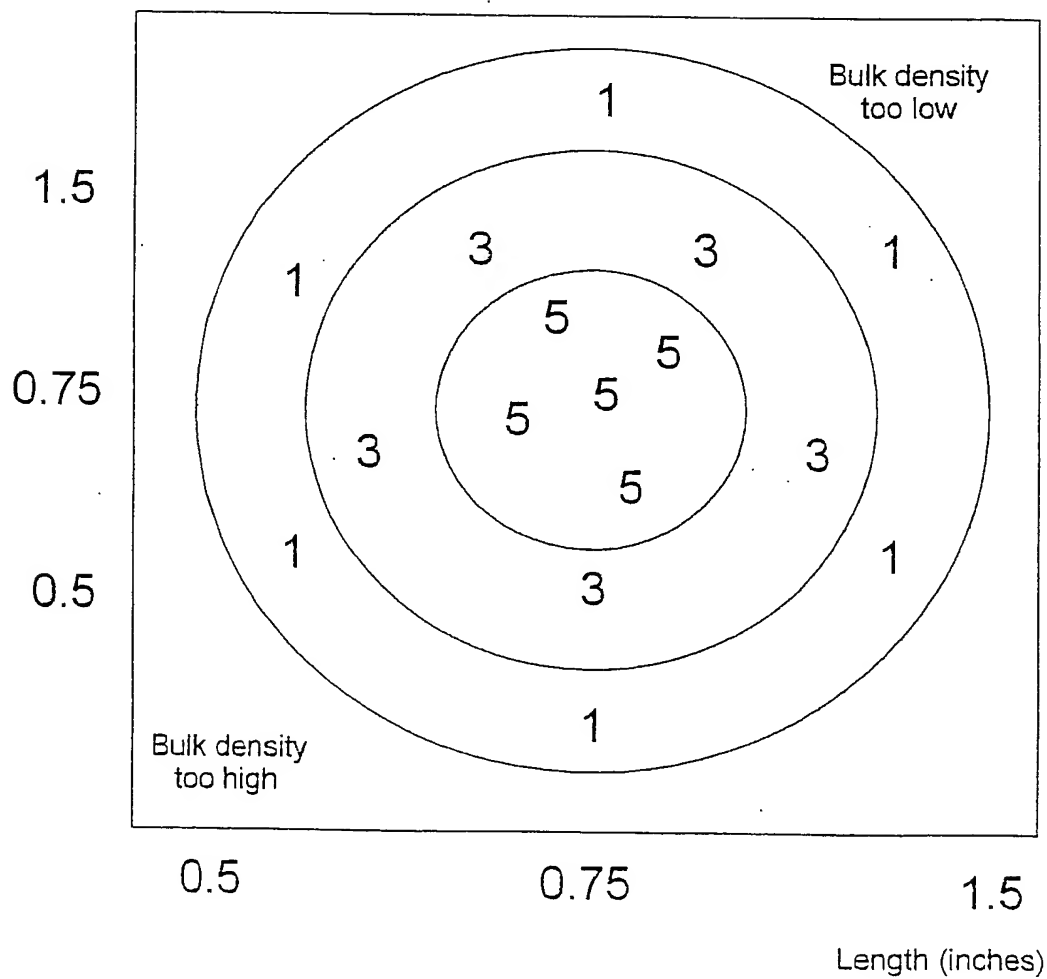


FIGURE 5

Scrub Tower Relative Tail Removal Efficiency

(5 = High Efficiency 1 = Low Efficiency)

PSI

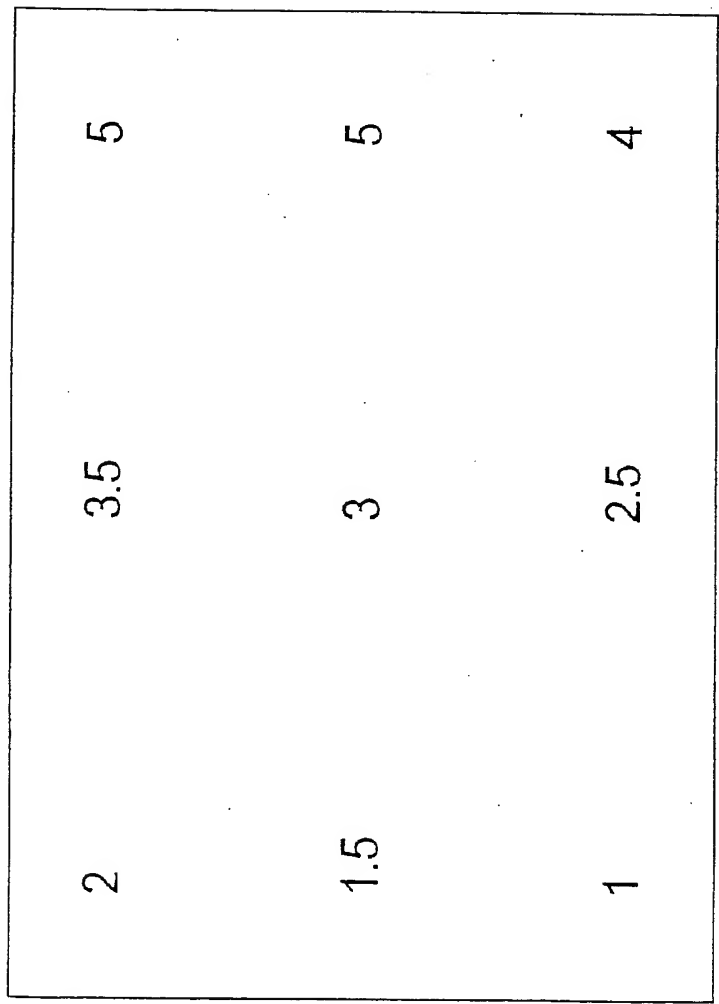

20 60 100 GPM

FIGURE 6

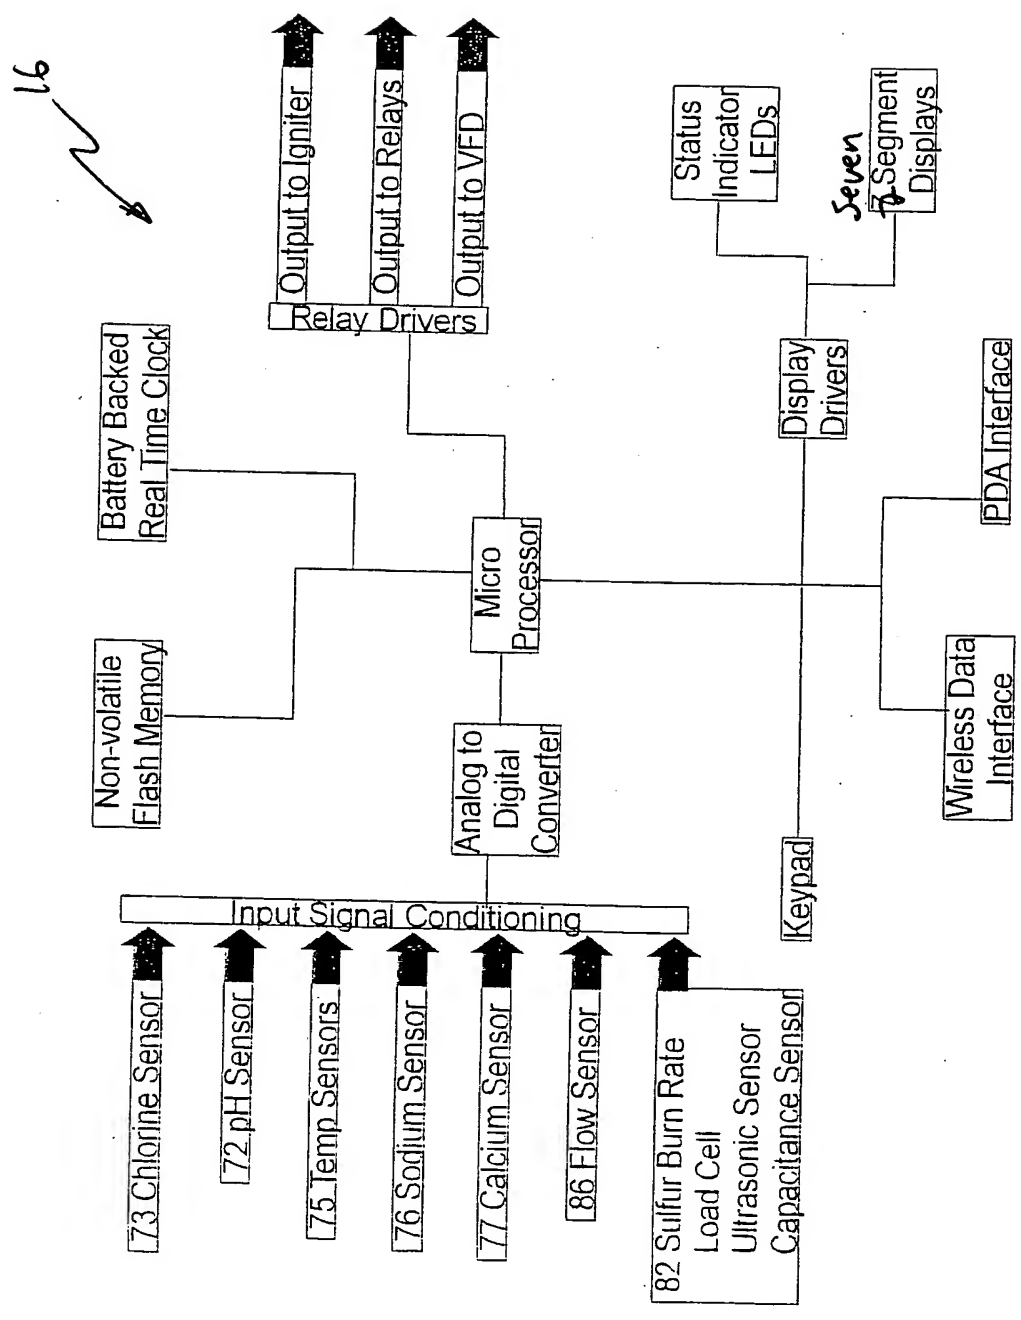


FIGURE 7

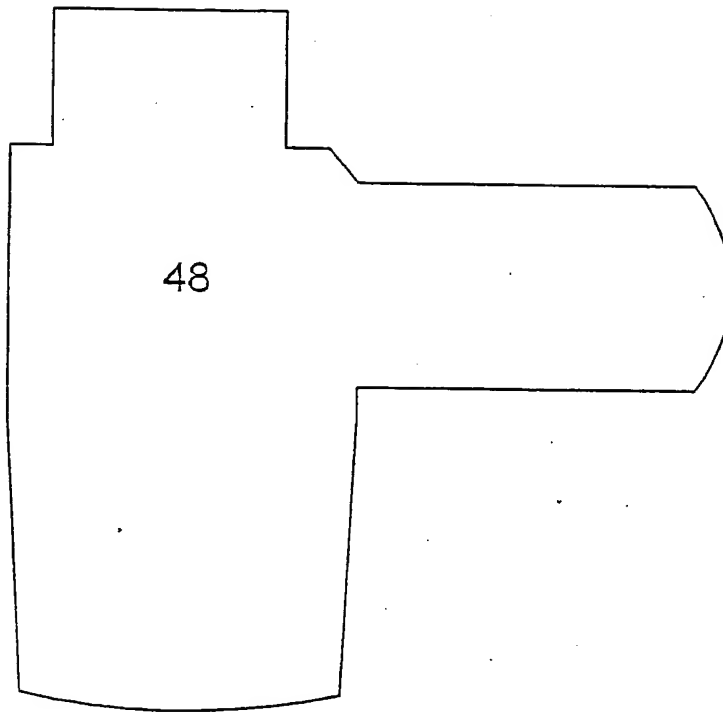


FIGURE 8

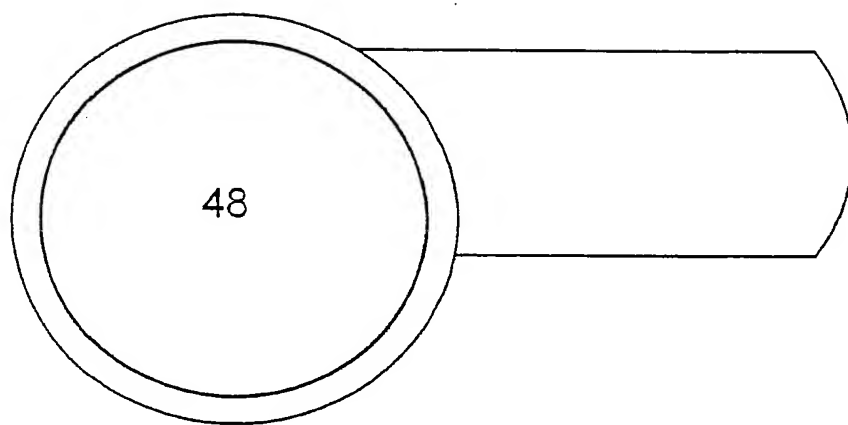


FIGURE 9